


EAST JORDAN NO.
1020 FRAME (OR
APPROVED EQUAL) AND
SOLID LID WITH
CONCEALED PICKHOLES.
LID SHALL HAVE THE
WORDS "CITY OF
BATAVIA", "STORM"
(SEE STORM MANHOLE
LID DETAIL)

PRECAST CONCRETE
RINGS 8" MAX. WITH
BITUMINOUS MASTIC
BED FOR EACH
RING AND CASTING.

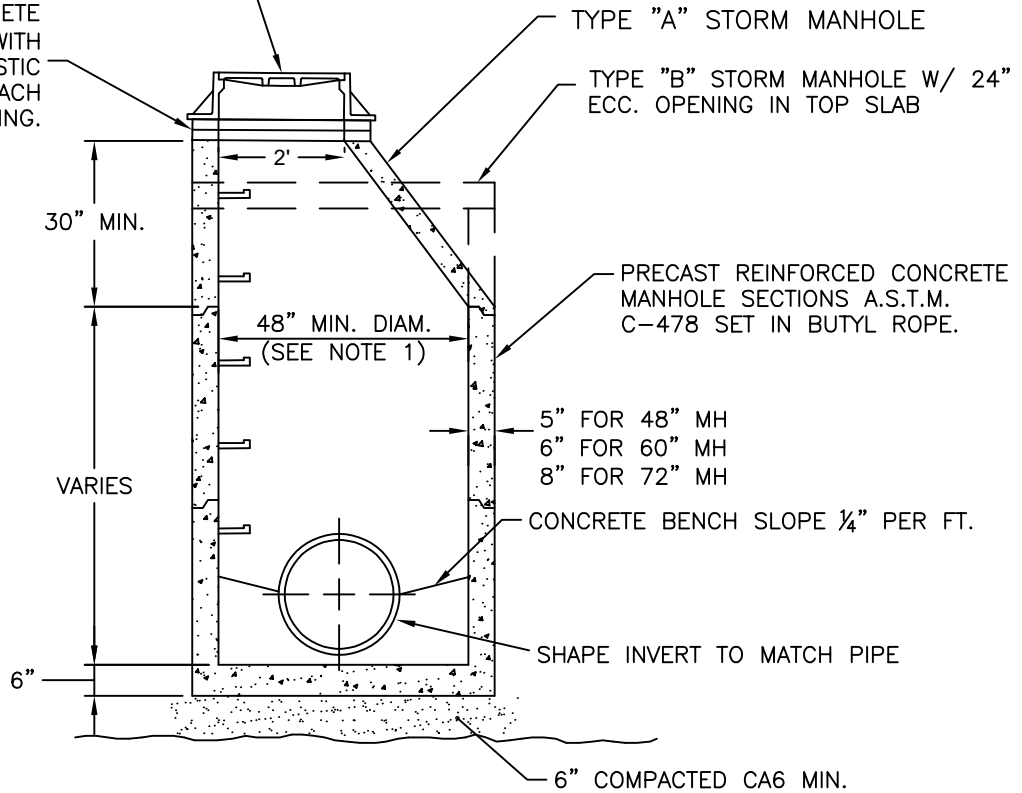

NOTE:

1. MINIMUM STORM STRUCTURE DIAMETER IS 48". THE INSIDE DIAMETER SHALL BE DETERMINED BASED ON THE SIZE AND ORIENTATION OF THE STORM SEWERS ENTERING THE MANHOLE. REFER TO THE APPROVED PLANS FOR THE REQUIRED STORM MANHOLE DIAMETERS. TYPICALLY, A 4' DIA. MANHOLE IS REQUIRED FOR STORM SEWER SIZES 8" THRU 18", 5' DIA. MANHOLE FOR 21" THRU 42", AND 6' DIA. MANHOLE FOR 48" AND ABOVE.



**CITY OF
BATAVIA**

**CITY OF BATAVIA
PUBLIC WORKS DEPARTMENT**

SHEET: 1 OF 1
DATE: 1/1/16

STORM SEWER MANHOLE - TYPE "A" OR TYPE "B"

STANDARD NO. 4.02