


CORE HOLE IN WALL FOR RESTRICTOR. RESTRICTOR NO LESS THAN 4". REFER TO BELOW FOR RESTRICTOR SIZE REQUIREMENT.

PLAN

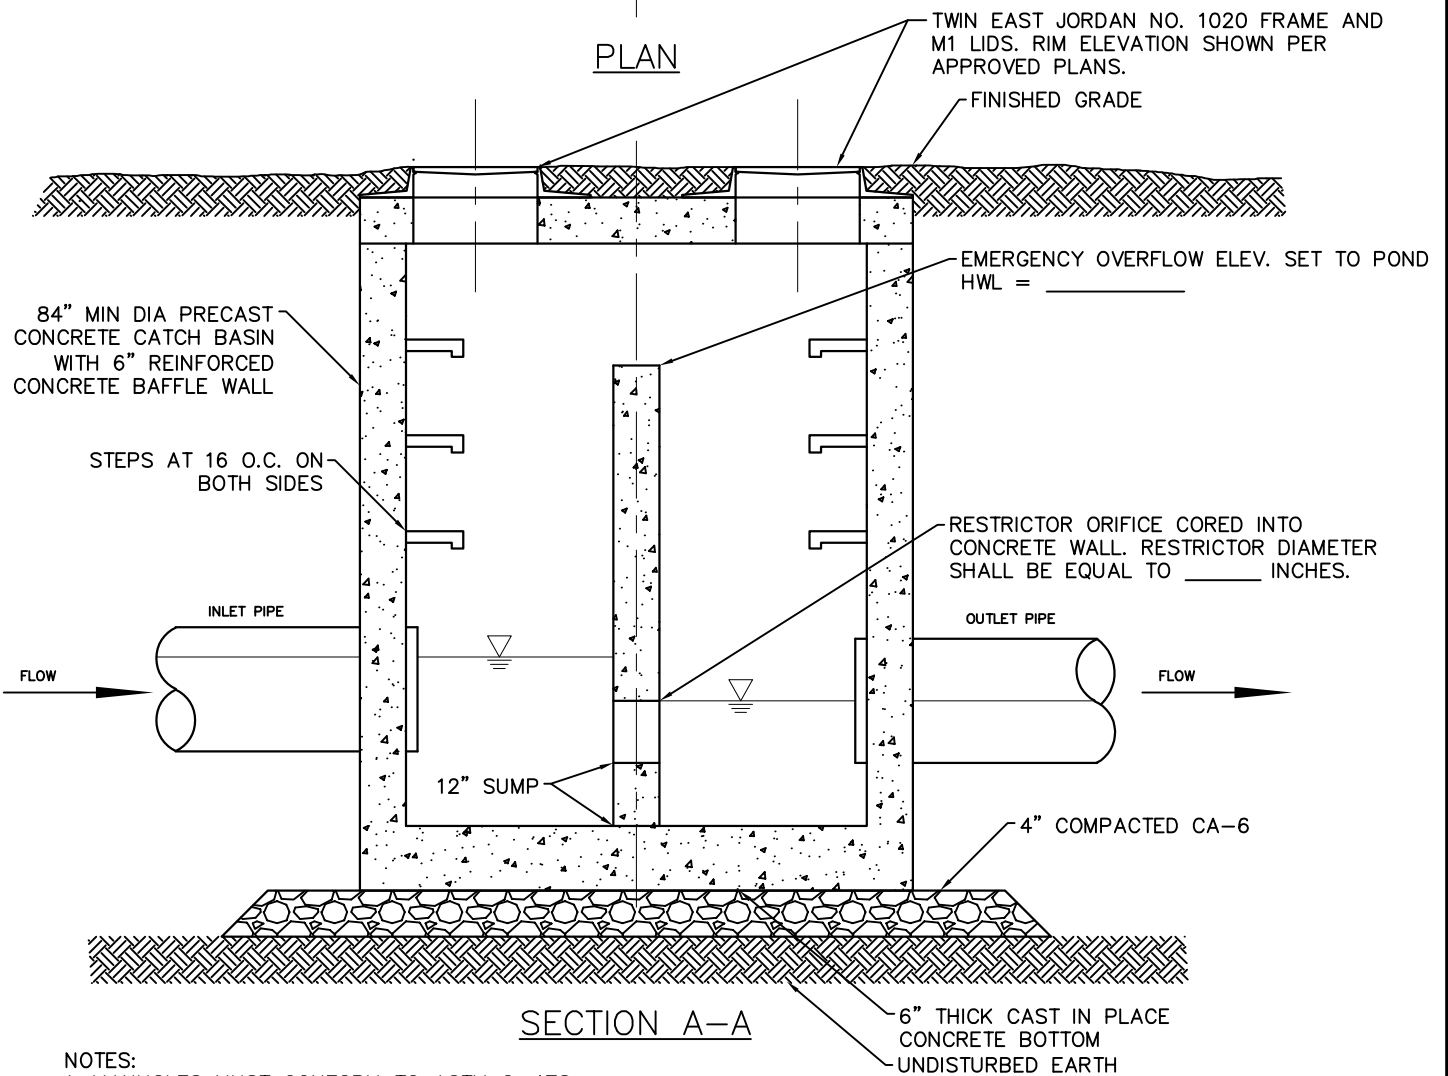

SECTION A-A

NOTES:

1. MANHOLES MUST CONFORM TO ASTM C-478.
2. MANHOLE SECTIONS TO BE TONGUE AND GROOVED.
3. NON-PRECAST OPENINGS SHALL BE CORED AND RUBBER BOOTED.
4. MORTAR ALL PIPE PENETRATIONS INSIDE AND OUTSIDE OF STRUCTURE.



**CITY OF
BATAVIA**

**CITY OF BATAVIA
PUBLIC WORKS DEPARTMENT**

SHEET: 1 OF 1
DATE: 1/1/16

RESTRICTOR DETAIL

STANDARD NO. 4.09