



WHEN PROPOSED SEWER (OR WATER) IS LOCATED TEN (10) FEET OR MORE FROM EXISTING WATER (OR SEWER), NO SPECIAL CONSTRUCTION REQUIRED.

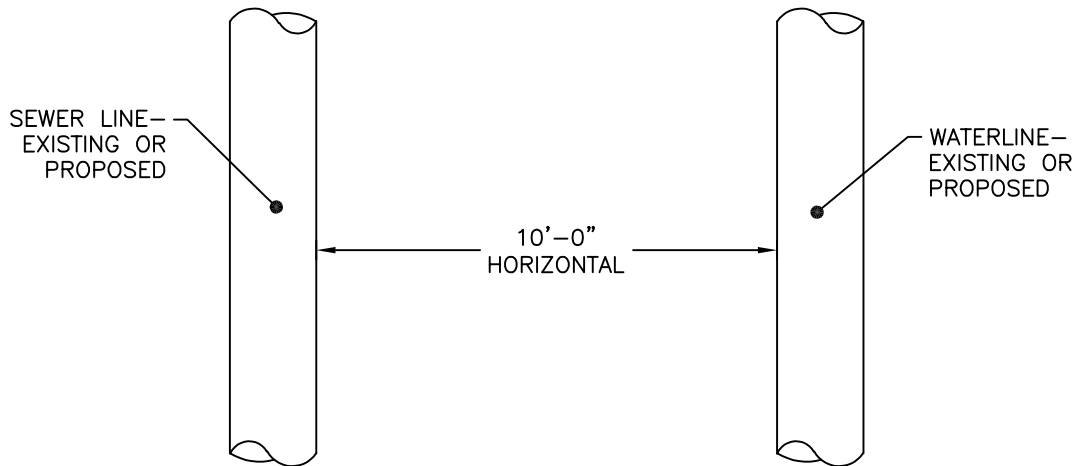

PLAN VIEW

WHEN PROPOSED SEWER (OR WATER) IS LOCATED LESS THAN TEN (10) FEET FROM EXISTING WATER (OR SEWER) THE DETAIL BELOW SHALL APPLY.

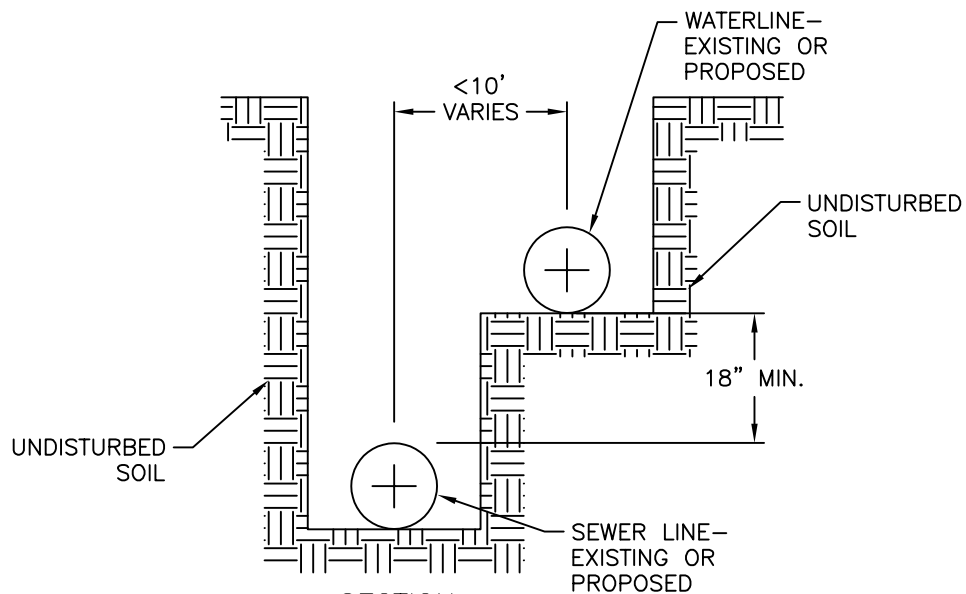

SECTION

NOTES:

1. FOR FURTHER INFORMATION REGARDING THE WATER AND SEWER SEPARATION REQUIREMENTS SEE THE LATEST EDITION OF THE "ILLINOIS STANDARDS SPECIFICATION FOR SEWER AND WATER CONSTRUCTION IN ILLINOIS."
2. REFER TO THE CITY OF BATAVIA "WATER MAIN CROSSING" DETAIL FOR DETAILED REQUIREMENTS FOR PROPOSED WATER MAIN CROSSING UNDER A SEWER.

NOT TO SCALE



**CITY OF BATAVIA  
PUBLIC WORKS DEPARTMENT**

**SHEET: 1 OF 1  
DATE: 1/1/16**

**WATER AND SEWER SEPARATION**

**STANDARD NO. 6.05**