


**REQUIRED WHEN A 10' MINIMUM SEPARATION IS
NOT POSSIBLE FOR WATER AND SEWER SERVICES**

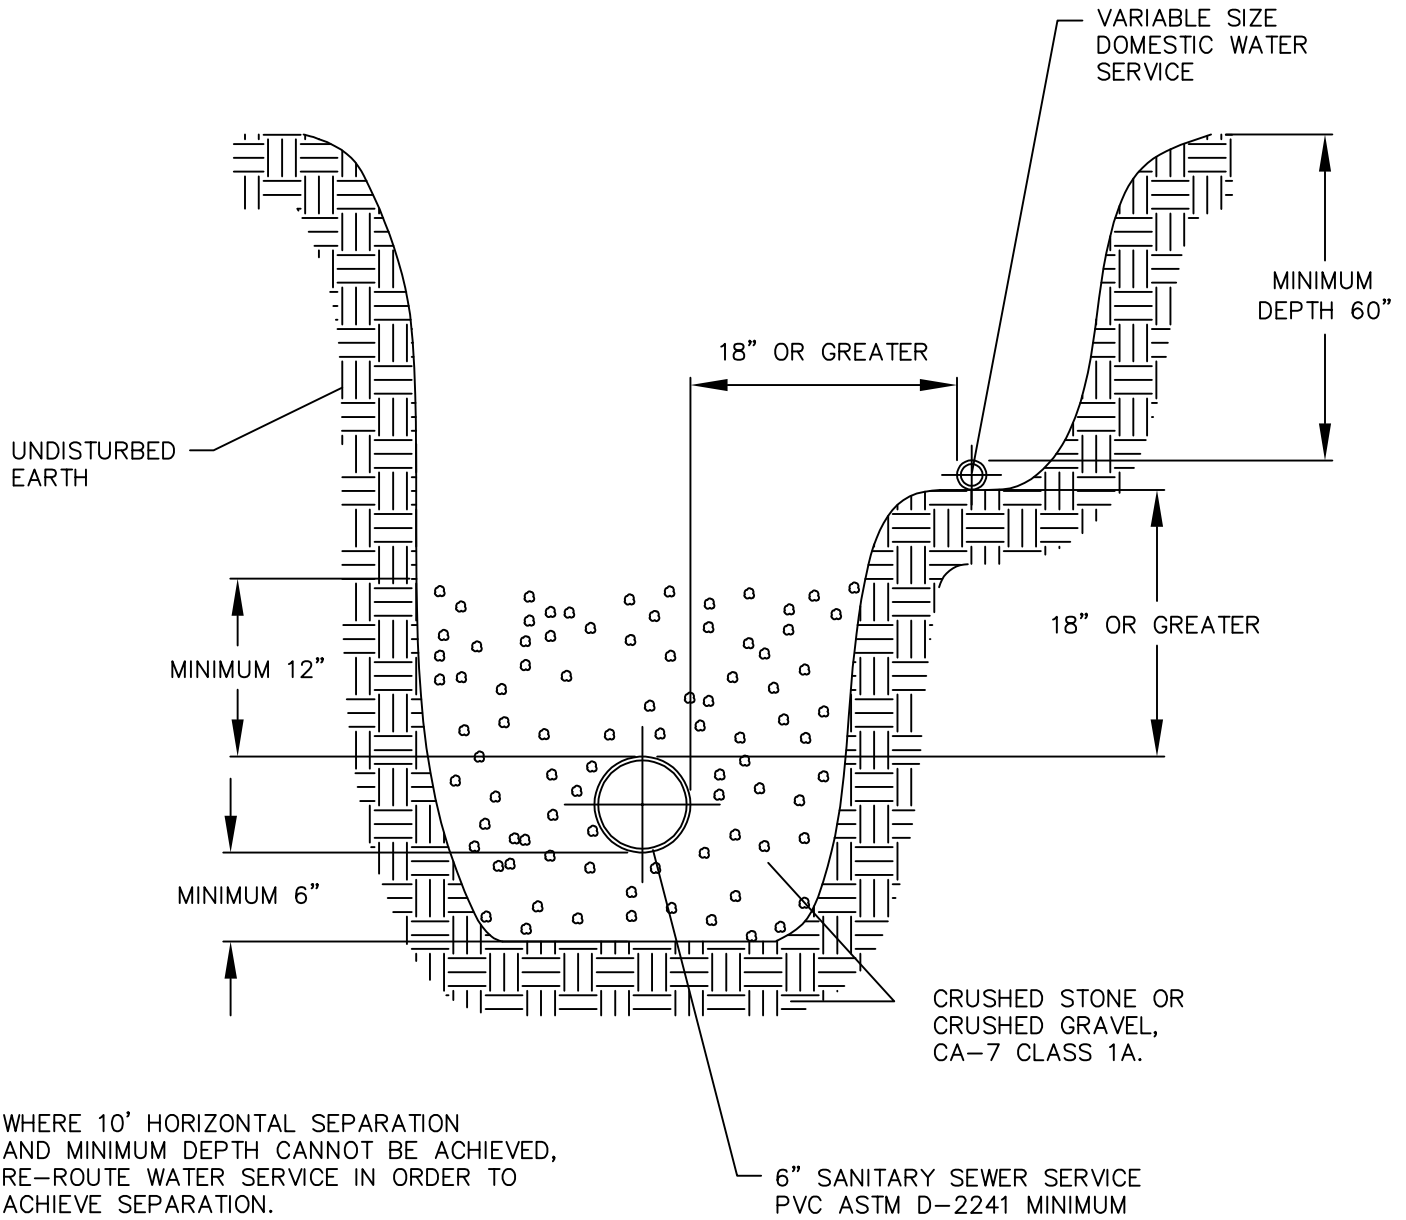

NOTE

INSTALL PER "77 ILL. ADMIN. CODE PART 890
ILLINOIS PLUMBING CODE" LATEST EDITION.

**SANITARY SEWER SERVICE & POTABLE
WATER SERVICE SEPARATION**



**CITY OF
BATAVIA**

**CITY OF BATAVIA
PUBLIC WORKS DEPARTMENT**

SHEET: 1 OF 1
DATE: 1/1/16

WATER SEWER SEPARATION

STANDARD NO. 6.11