


PLUG/CAP DETAILS

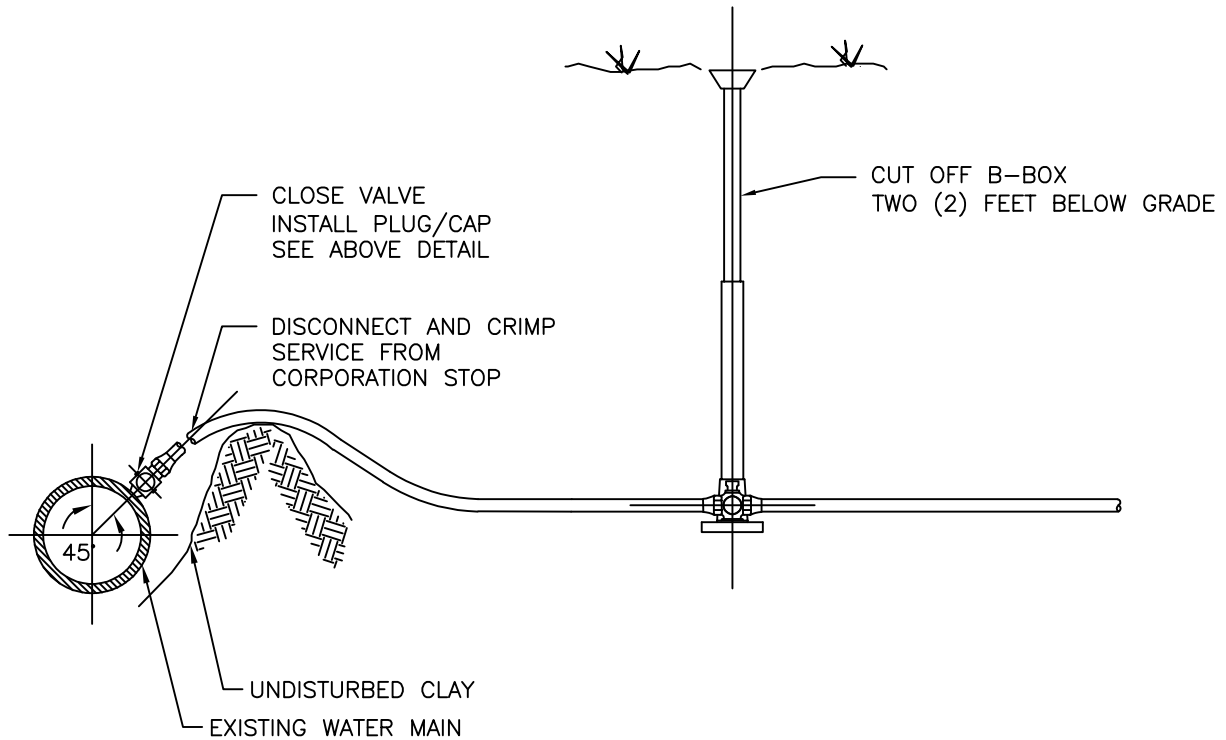

NOTES:

1. PRIOR WATER DEPARTMENT APPROVAL REQUIRED
2. CITY OF BATAVIA WATER DEPARTMENT SHALL WITNESS THE WATER SERVICE ABANDONMENT PRIOR TO BACKFILLING. CALL COMMUNITY DEVELOPMENT 48 HOURS PRIOR TO SCHEDULE INSPECTIONS.
3. EXISTING CORPORATION AND CURB STOP SHALL BE TURNED TO THE CLOSED POSITION AND EXISTING B-BOX CUT OFF TWO FEET BELOW GRADE AND REMOVED
4. CRIMP SOFT PIPES WITHIN ONE FOOT OF DISCONNECTED SERVICE LINE. USE THREADED CAP FOR RIGID THREADED STEEL PIPES.
5. THIS DETAIL APPLIES 1/2" TO 2" SERVICE LINES

NOT TO SCALE



**CITY OF
BATAVIA**

**CITY OF BATAVIA
PUBLIC WORKS DEPARTMENT**

SHEET: 1 OF 1
DATE: 1/23/18

WATER SERVICE ABANDONMENT DETAIL

STANDARD NO. 6.12